


UMF3000-6000FM FIT OFF GUIDE

GENERAL ASSEMBLY

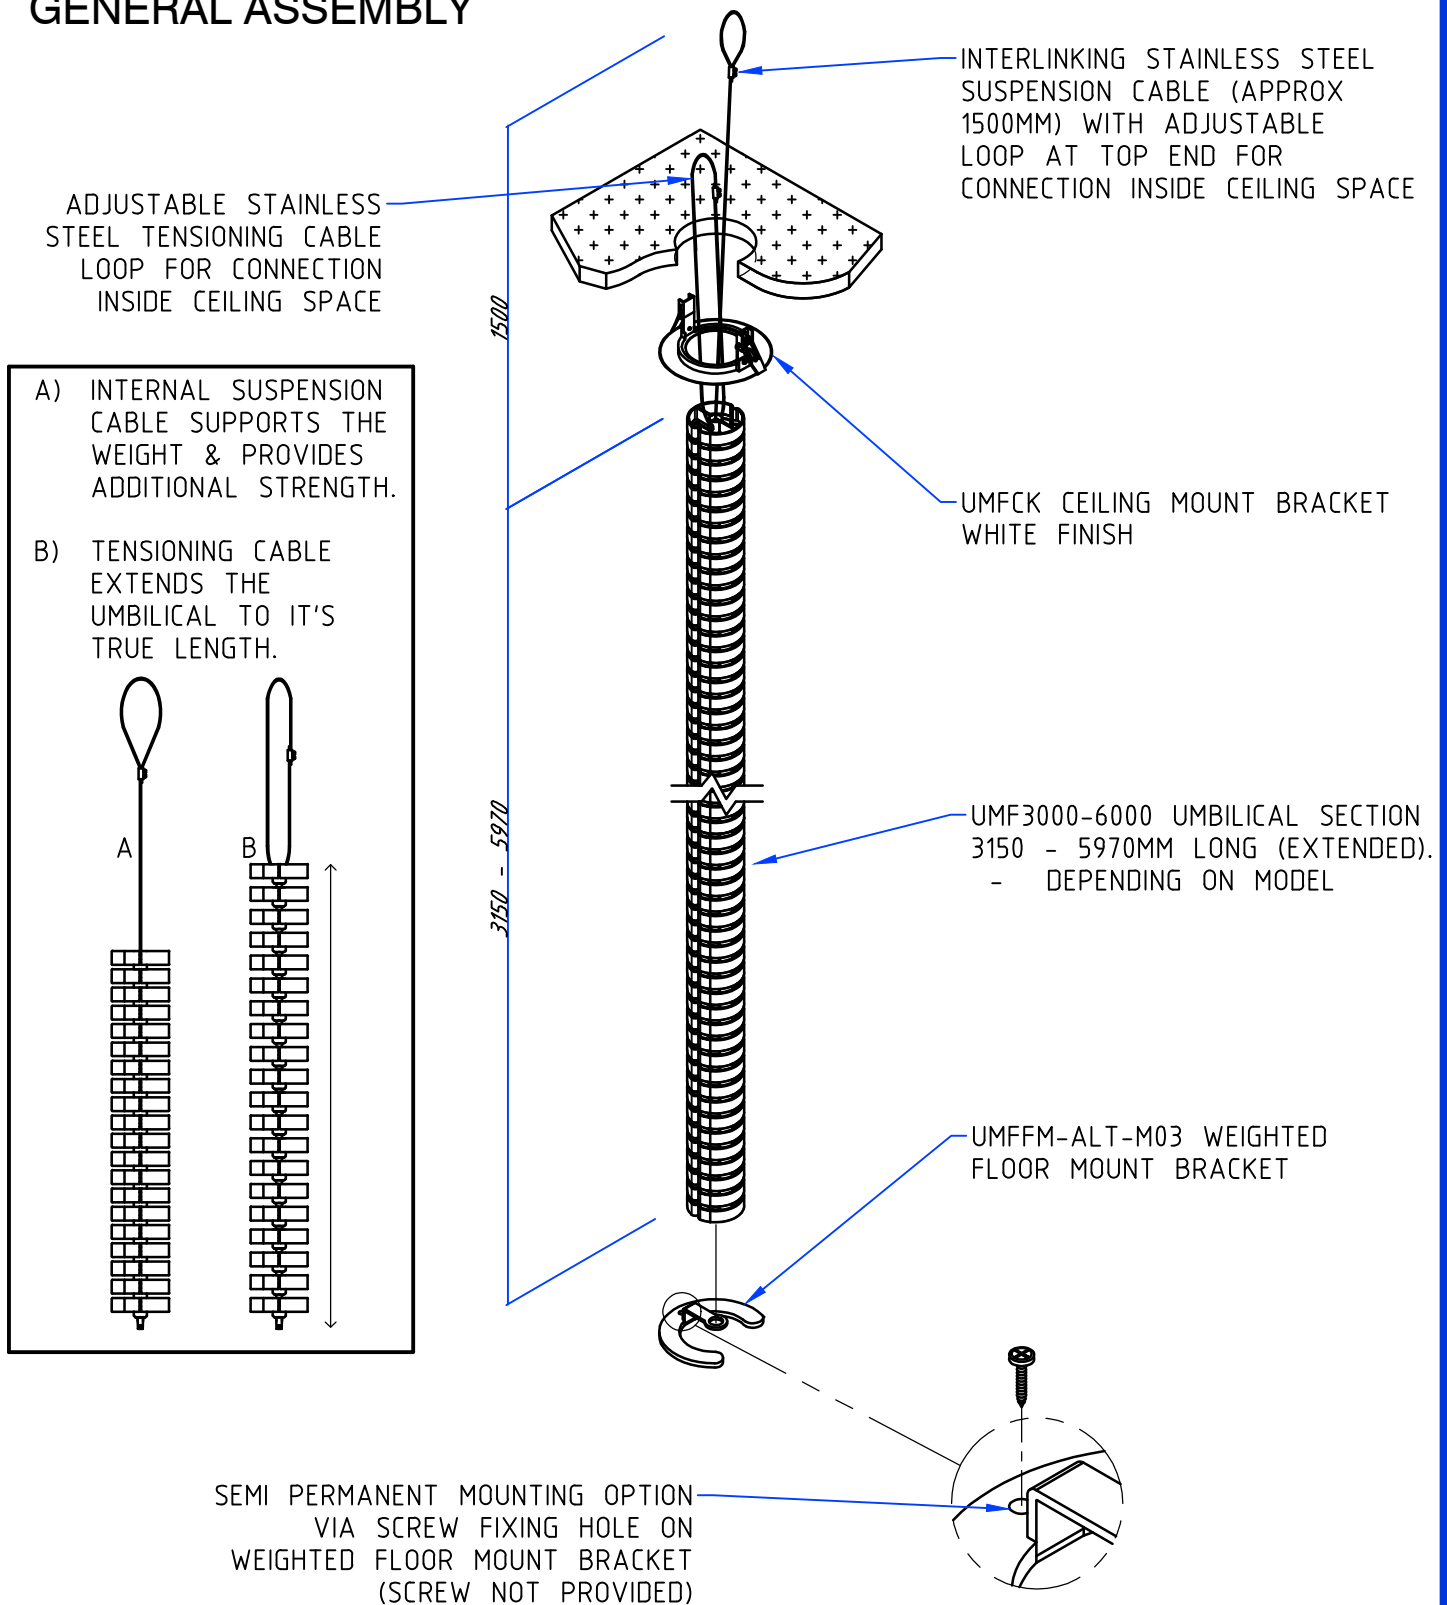

ECD

ECD

ECD

ECD

ECD

ECD



ESTABLISHED 1979

Electric Cable Duct Systems Pty. Ltd.


Ph: 1300 123 ECD (323) Fax: (03) 9899 5042

Email: info@ecd.net.au


www.ecd.net.au

ABN 80005544105


FOR PACKING & SHIPPING CONVENIENCE THIS UMF FLOOR MOUNT UMBILICAL HAS BEEN SUPPLIED PARTIALLY ASSEMBLED. TO COMPLETE THE ASSEMBLY SIMPLY SNAP TOGETHER THE SECTIONS AT POINTS A & B, THEN THE WEIGHTED FOOT AT POINT C. NOTE FIRST ENSURE THE INTERLINKING SUSPENSION CABLE IS PULLED TIGHT.

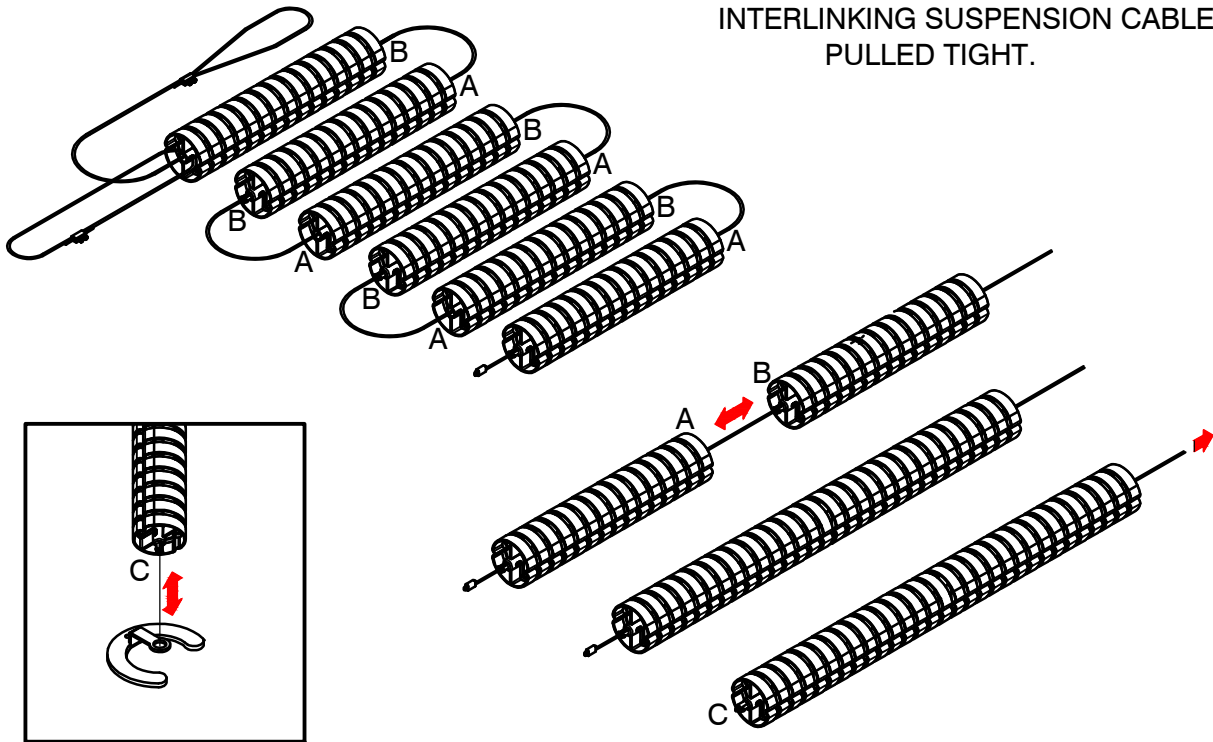


CEILING MOUNTING DETAIL

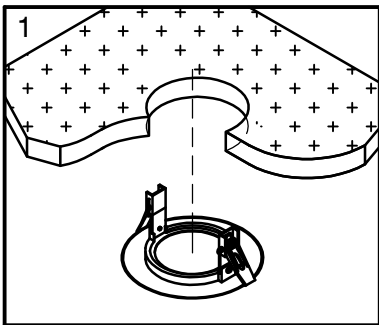


1 CUT 105MMØ OPENING IN DESIRED LOCATION FOR CEILING MOUNT BRACKET.

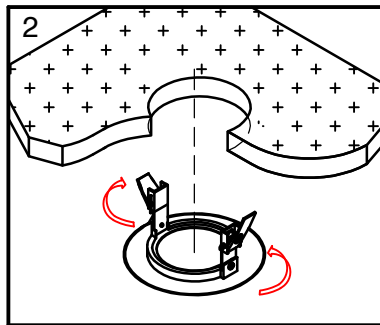


2 OPEN SPRING MECHANISMS ON CEILING MOUNT BRACKET.

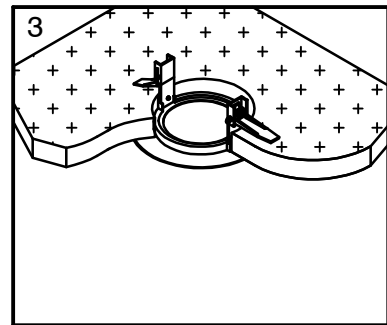


3 INSERT CEILING MOUNT BRACKET.

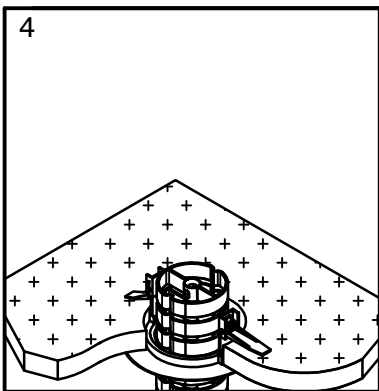

4 INSERT TOP OF UMBILICAL THROUGH CEILING MOUNT BRACKET.

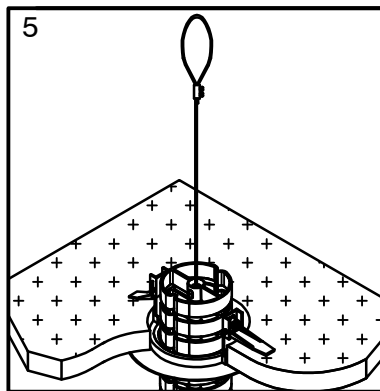

5 SECURE UMBILICAL INSIDE THE CEILING SPACE USING SUSPENSION CABLE. NOTE: MAY REQUIRE ADJUSTMENT AFTER FITTING UMBILICAL TO DESK.

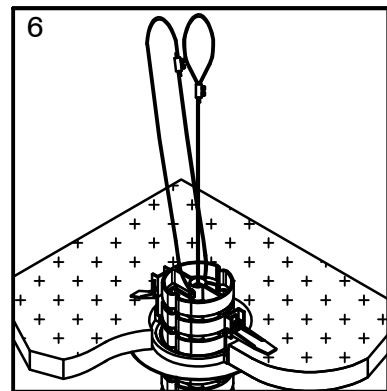

6 SECURE TENSIONING CABLE INSIDE THE CEILING SPACE. NOTE: MAY REQUIRE ADJUSTMENT AFTER FITTING UMBILICAL TO DESK.